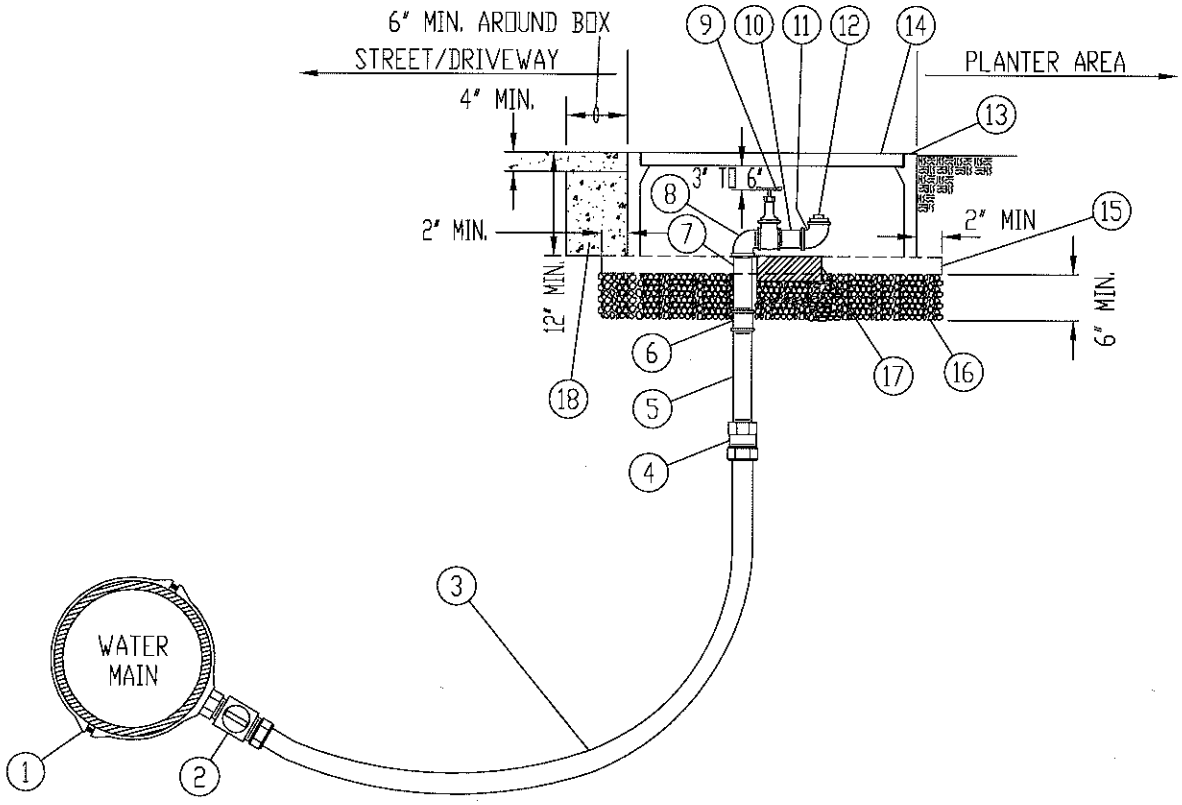

NOTES:

- BOLT TORQUE ON ALL FITTINGS SHALL CONFORM TO MANUFACTURER'S SPECIFICATIONS.
- MATERIAL BELOW CRUSHED ROCK SHALL BE COMPACTED TO 95% MINIMUM.
- LID SHALL BE MARKED "WATER"
- VALVE OPERATING HANDLE SHALL BE CENTERED IN BOX AND FULLY ACCESSIBLE.
- CONCRETE ENCASEMENT SHALL BE ALLOWED TO CURE 24 HOURS MINIMUM PRIOR TO FINISH PAVING.

1	2" BRONZE SADDLE - IPT	11	2" BRASS 90° ELBOW			
2	2" CORPORATION STOP - FULL-PORT BALL, MIP x CTS COMP	12	2" BRASS PLUG, FINGER TIGHT			
3	2" COPPER TUBING - TYPE K SOFT			NON-TRAFFIC AREA	SIDEWALK/DW	STREET
4	2" BRASS ADAPTER - CTS COMP X FIP	13	BOX	CARSON 1220-12	CHRISTY FL30TBOX12	CHRISTY B1324BOX
5	2" X 24" BRASS NIPPLE	14	LID	CARSON 1220-4B	CHRISTY FL30T	CHRISTY B1324-61JH
6	2" BRASS COUPLING - ONE ONLY	15	2" x 6" PRESSURE TREATED DOUGLAS FIR SUPPORTS (2)			
7	2" BRASS NIPPLE - ONE ONLY, LENGTH AS NECESSARY TO ADJUST TO PROPER GRADE	16	3/4" CLEAN CRUSHED ROCK			
		17	CONCRETE BRICK - 2 1/4" x 3 3/4" x 7 1/2"			
8	2" BRASS STREET ELBOW	18	CONCRETE ENCASEMENT AROUND VALVE BOX-TYPE II SIX-SACK PORTLAND CEMENT			
9	2" BRASS GATE VALVE-NIBCO T-113LF OR EQUAL w/ 4" BRASS HANDWHEEL					
10	2" X 3" BRASS NIPPLE					

CITRUS HEIGHTS WATER DISTRICT

2" BLOW-OFF VALVE - IN-LINE

CITRUS HEIGHTS WATER DISTRICT

APPROVED BY: Robert A. Churchill
CITRUS HEIGHTS WATER DISTRICT

DATE: 7/31/15

DRAWN: 29 JULY 2015
REVISED:
SCALE: N.T.S.
DESIGN: P.A.D.
CAD FILE: BO_512.DWG
PAGE: BO_512