


COMPACTION AROUND BOX:
 NON-TRAFFIC: 90% MIN.
 TRAFFIC: 95% MIN.

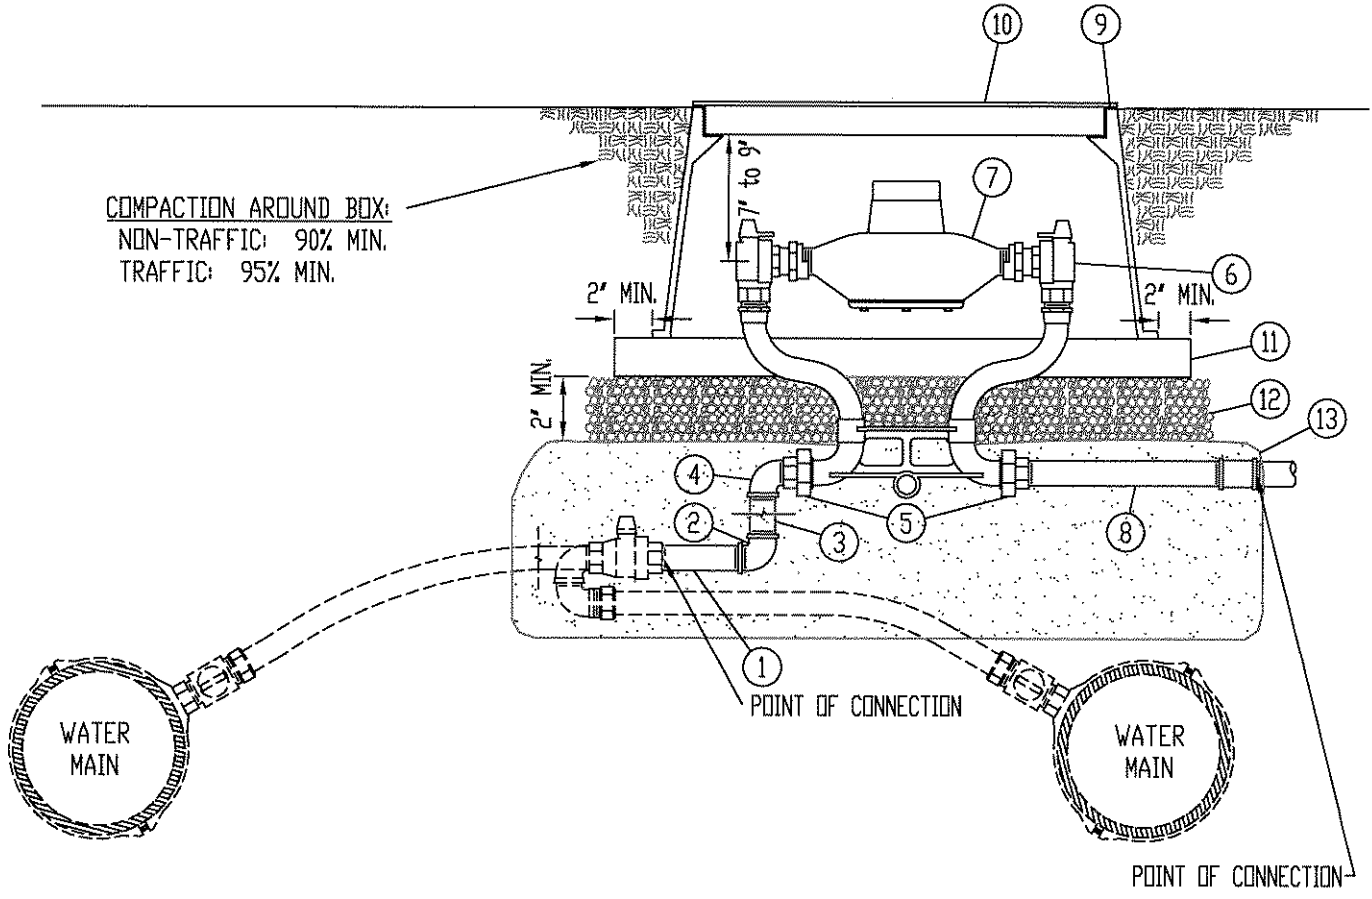

CARSON 1220-4B 'T' TYPE LID:
 SHALL INCLUDE STRAIGHT TYPE
 HEXAGON LOCK-DOWN BOLT (1)
 SHALL BE MARKED 'WATER'

CHRISTY FL30T RECESSED LID:
 SHALL INCLUDE STRAIGHT TYPE
 PENTAHEAD LOCK-DOWN BOLTS (2).
 SHALL BE MARKED 'WATER'

METER YOKE:
 FORD, JONES, MUELLER, McDONALD

1	1' x 3' BRASS OR COPPER NIPPLE	7	1' WATER METER - RADIO READ (BY DISTRICT)
2	1' BRASS ELBOW	8	1' x 18' PVC NIPPLE - SCH 80
3	1' BRASS OR COPPER (AS NECESSARY TO ADJUST TO PROPER GRADE)		NON-TRAFFIC AREAS
4	1' BRASS STREET ELBOW	9	METER BOX
5	1' DUAL PURPOSE CONNECTION	10	LID
6	1' COPPER/BRASS METER YOKE - 12' HEIGHT w/2 FULL-PORT ANGLE BALL VALVES INCLUDING PADLOCK WINGS ON INLET AND OUTLET	11	2' x 6' PRESSURE TREATED DOUGLAS FIR SUPPORTS (2)
		12	3/4' CLEAN CRUSHED ROCK
		13	#2 WASHED SAND COMPACTED TO 90%
			TRAFFIC AREAS
			CARSON 1220-12
			CHRISTY FL30TB0X12
			CARSON 1220-4B
			CHRISTY FL30T



1" WATER SERVICE - 1" METER RETROFIT

CITRUS HEIGHTS WATER DISTRICT

APPROVED BY: *Robert A. Carpio* DATE: *4/13/2009*
 CITRUS HEIGHTS WATER DISTRICT

DRAWN: 13 APR 2009
 REVISED:
 SCALE: N.T.S.
 DESIGN: P.A.D.
 CAD FILE: WS_103.DWG
 PAGE: **WS_103**