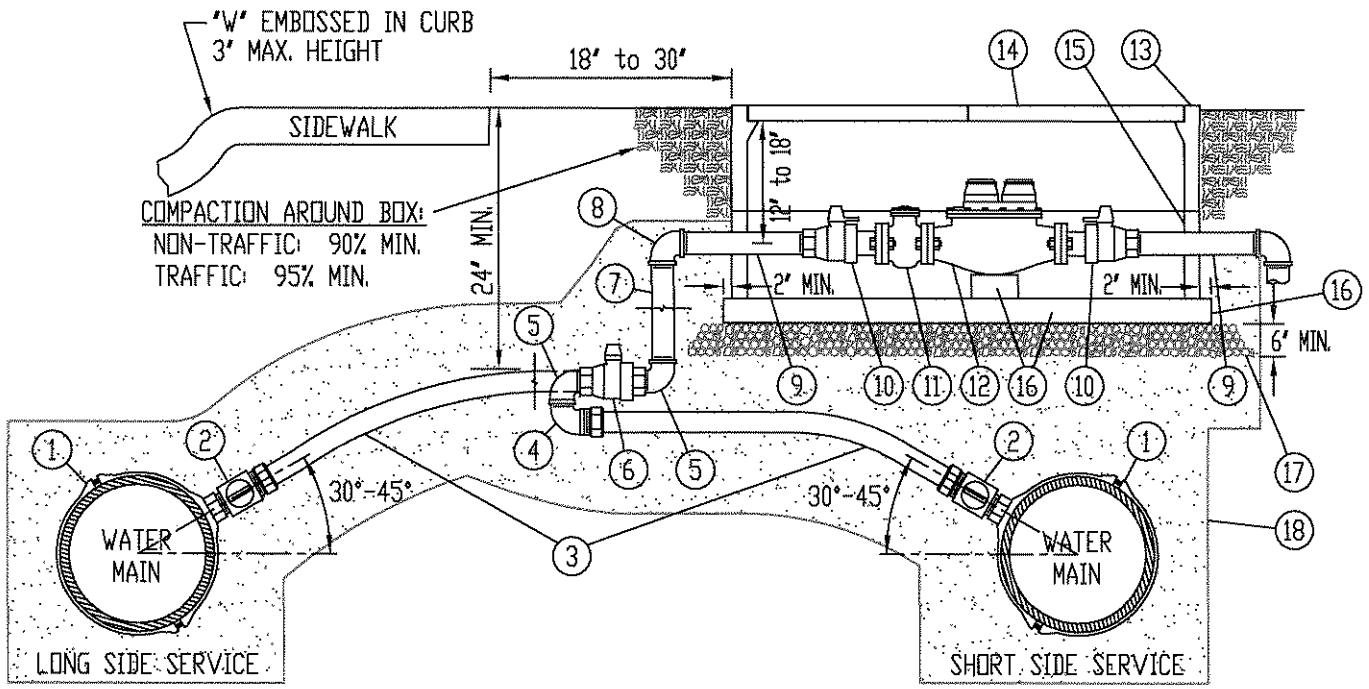

NOTES:

1. VOIDS AROUND THE WATER MAIN AT THE ENTRY AND EXIT POINTS FROM THE METER BOX SHALL BE COMPLETELY GROUTED WITH MORTAR MIX.
2. LID SHALL BE MARKED "WATER"

1	2" BRONZE SADDLE - IPT	11	2" STAINER - NEPTUNE 53107-000 (BY CONTRACTOR)		
2	2" CORPORATION STOP - FULL-PORT BALL, MIP x CTS COMP	12	2" COMPOUND METER, NEPTUNE TRU/FLO, 100 cu. ft., RADIO READ (BY CONTRACTOR)		
3	2" COPPER TUBING - TYPE K SOFT				
4	2" BRASS STREET ELBOW - CTS COMP x MIP			NON-TRAFFIC AREAS	TRAFFIC AREAS
5	2" BRASS STREET ELBOW	13	METER BOX	CHRISTY B48BOX	CHRISTY B3048BOX
6	2" VALVE - FULL-PORT BALL, FIP x FIP or CTS COMP x FIP	14	COVER	CHRISTY B48-62J	CHRISTY B3048-63JH
7	2" BRASS (AS NECESSARY TO ADJUST TO PROPER GRADE)	15	BOX EXTENSION	CHRISTY B48x10	CHRISTY B3048X12
8	2" BRASS ELBOW	16	2" x 6" PRESSURE TREATED DOUGLAS FIR SUPPORTS (2)		
9	2" x 12" BRASS NIPPLE	17	3/4" CLEAN CRUSHED ROCK		
10	2" BALL VALVE - FIP x METER FLANGE INCLUDING PADLOCK WINGS	18	#2 WASHED SAND COMPACTED TO 90%		

CITRUS HEIGHTS WATER DISTRICT

2" WATER SERVICE - 2" COMPOUND METER
NEW CONSTRUCTION

CITRUS HEIGHTS WATER DISTRICT

APPROVED BY: Robert A. Churchill
CITRUS HEIGHTS WATER DISTRICT

DATE: 4/13/2009

DRAWN: 13 APR 2009
REVISED:
SCALE: N.T.S.
DESIGN: P.A.D.
CAD FILE: WS_202.DWG
PAGE: WS_202